


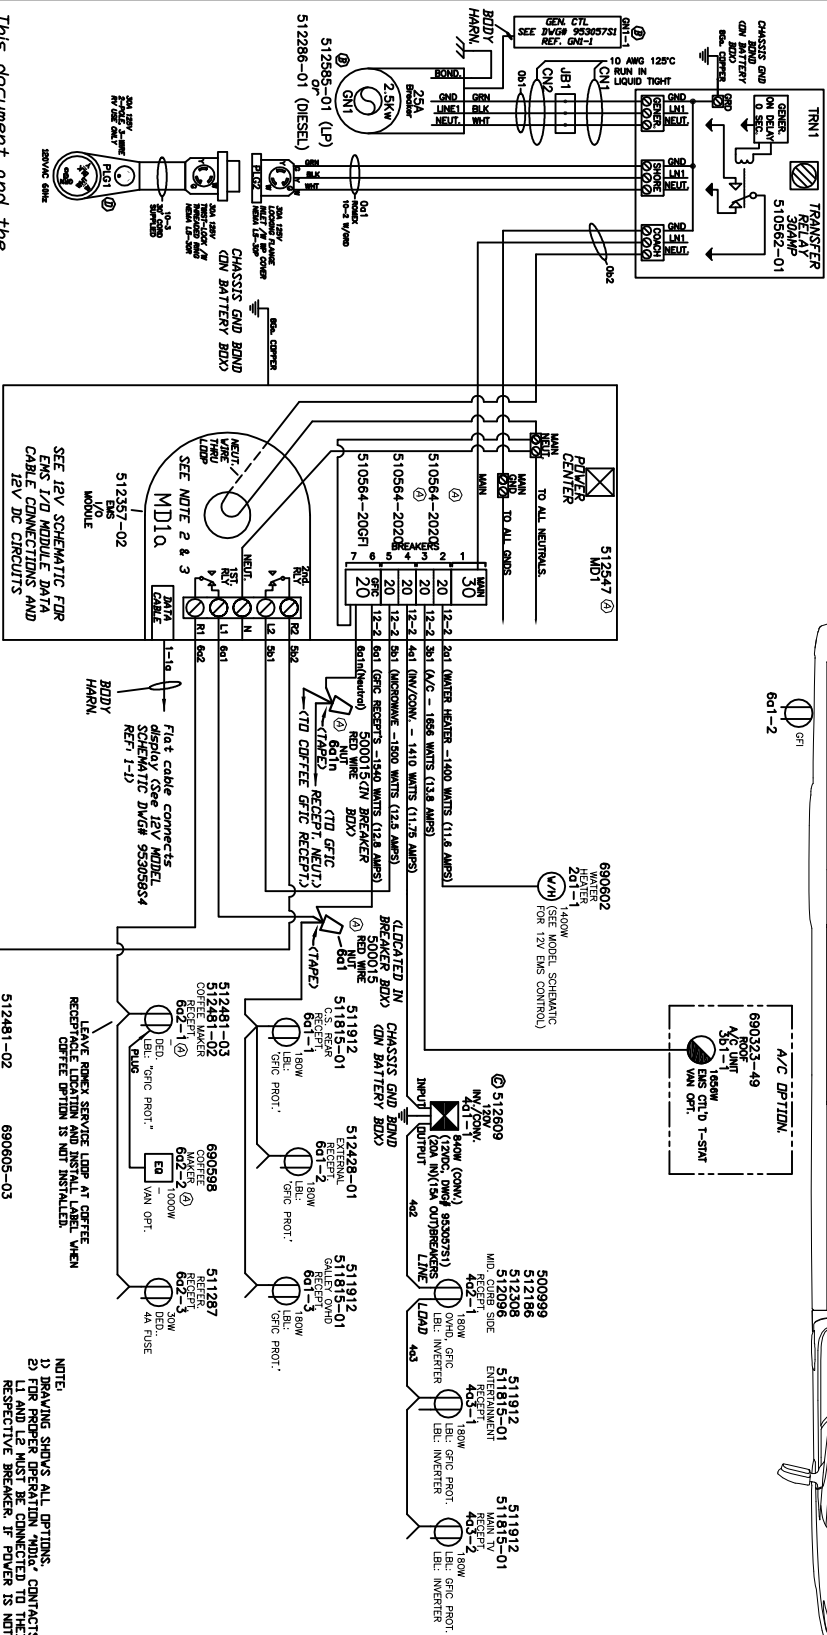

⊗	30	CIR.#1
⊗	20 20	CIR.#2
⊗	20 20	CIR.#3
⊗	20 20	CIR.#4
⊗	20 20	CIR.#4
⊗	20	CIR.#6

PLACE BREAKER
LABEL HERE. 2-1/4"

GFIC RECEPT. 20A (GFIC)	EMS BREAKER BOX CABLE
MICROWAVE (EMS) 20A	
INVERTER 20A (NOTE 1)	
AIR COND. 20A	
WATER HTR 20A	
MAIN 30A	

Ⓐ LABEL:

LABEL: STANDARD (NOTE: 1)

EMS SHED
PRINTER

ST	WATER HTR
END	A/C
ORD	COFF./REFRIG.
TH	MICRO.

ITEM	PART NUMBER	DESCRIPTION	QTY	UNIT
TELEPHONICS				
2		Airstream		
NEXT ASSY				
FIRST USAGE: INTERSTATE LODGE/2			APPROVED BY	
			BRIAN BY MI	

30A 110V LAYOUT USA

SHEET 1 OF 2

DRAWING NUMBER	953059S1	D	REV	D
----------------	----------	---	-----	---

This document and the information contained within are confidential and proprietary to Airstream, Inc. and shall not be copied, distributed or used in whole or in part without express written consent.